


Tue Sep 26 12:19:14 2006


TIDE Mass_0

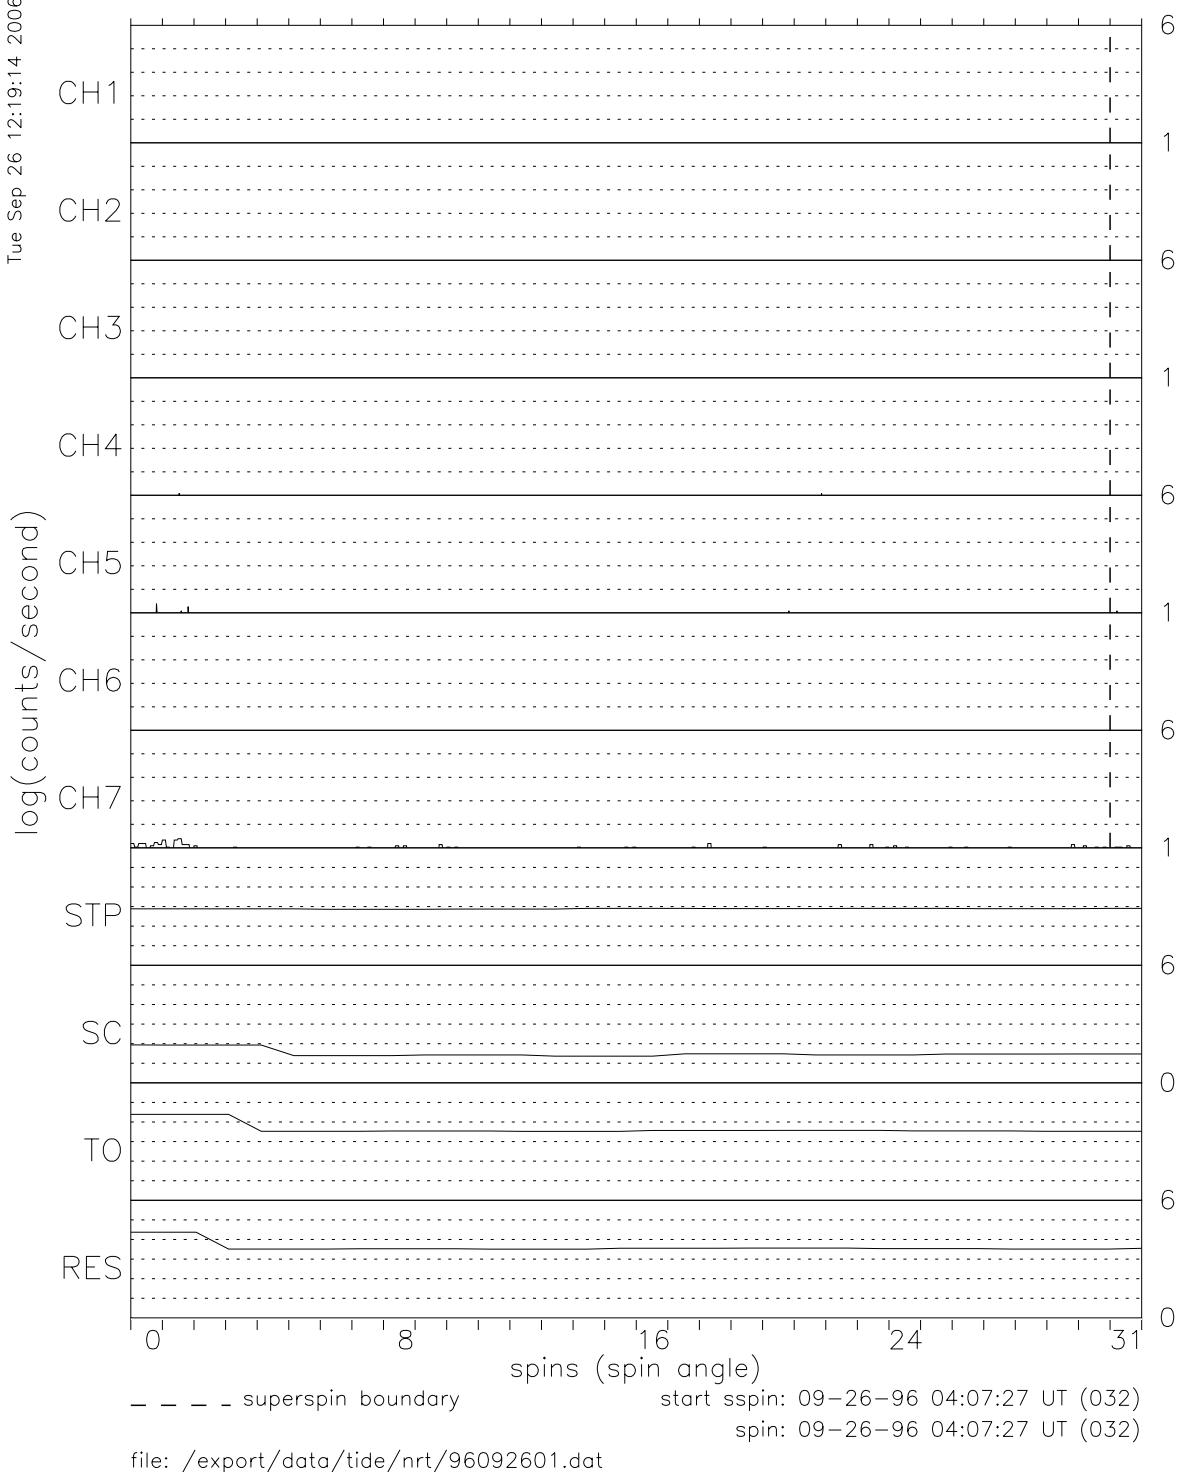

-15kV TOF: -9116 v
-3.6kV MCP: -2185 v
-2.4kV MCP: -1579 v
Input Cur: 302 ma
RPA max: 237 v
Mirror max: 238 v

Tue Sep 26 12:19:14 2006

TIDE Direct Events

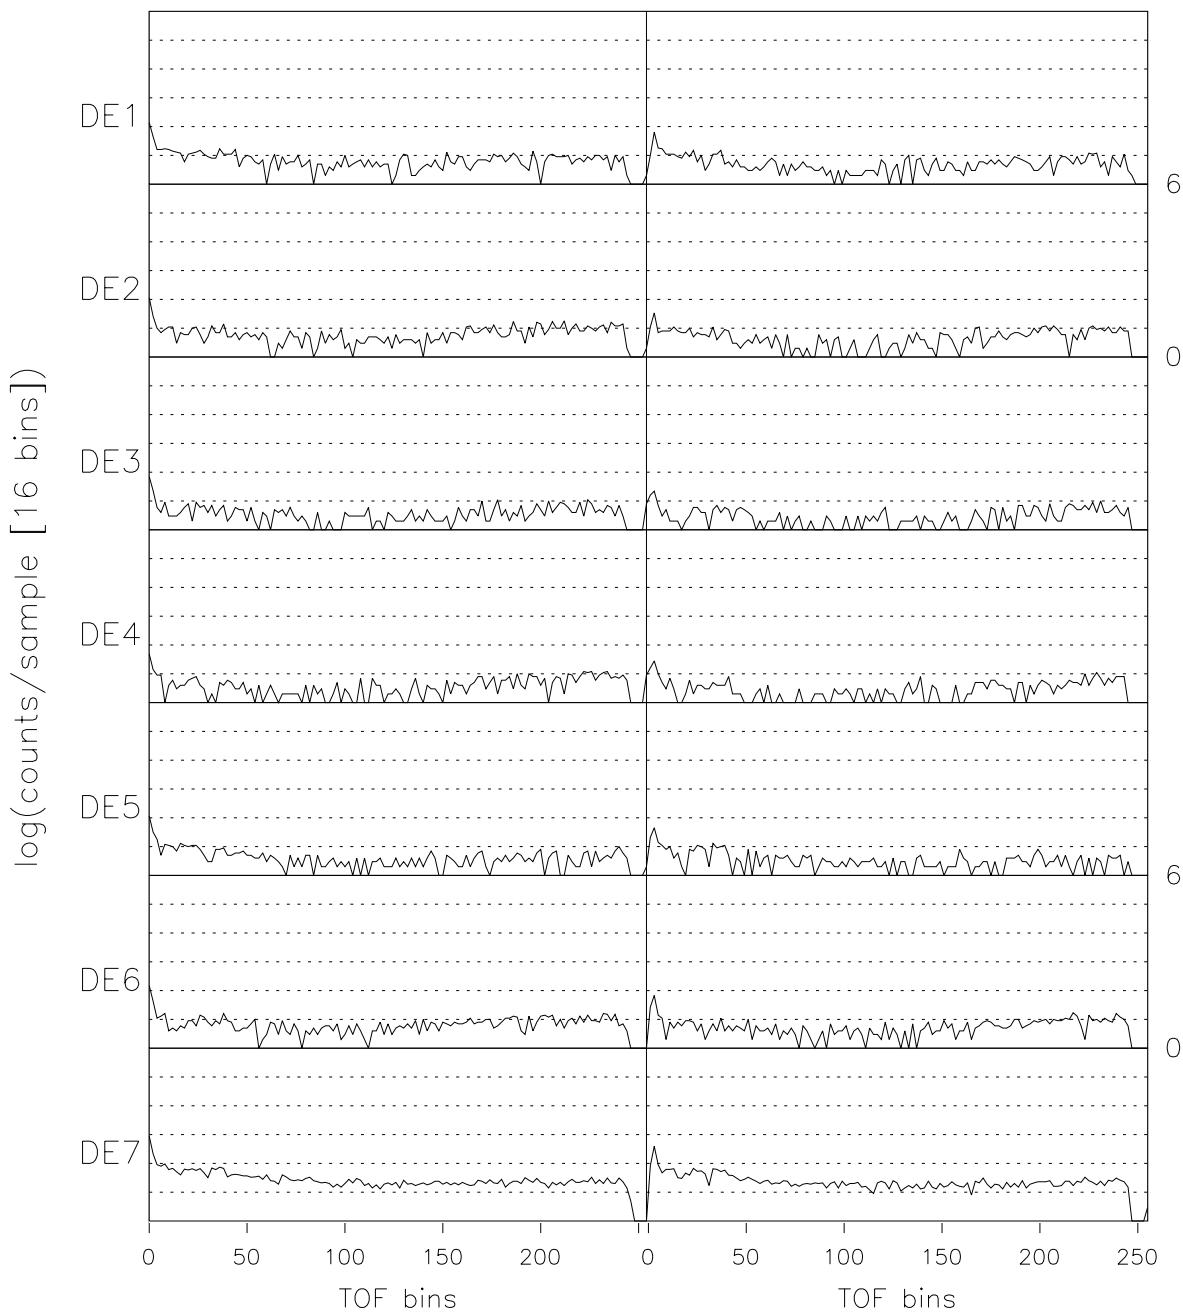

reported: 09-26-96 04:00:57 UT

reported: 09-26-96 04:04:09 UT

file: /export/data/tide/nrt/96092601.dat

-15kV TOF: -9116 v

-3.6kV MCP: -2593 v

-2.4kV MCP: -1579 v

Input Cur: 304 ma

RPA max: 237 v

Mirror max: 238 v